
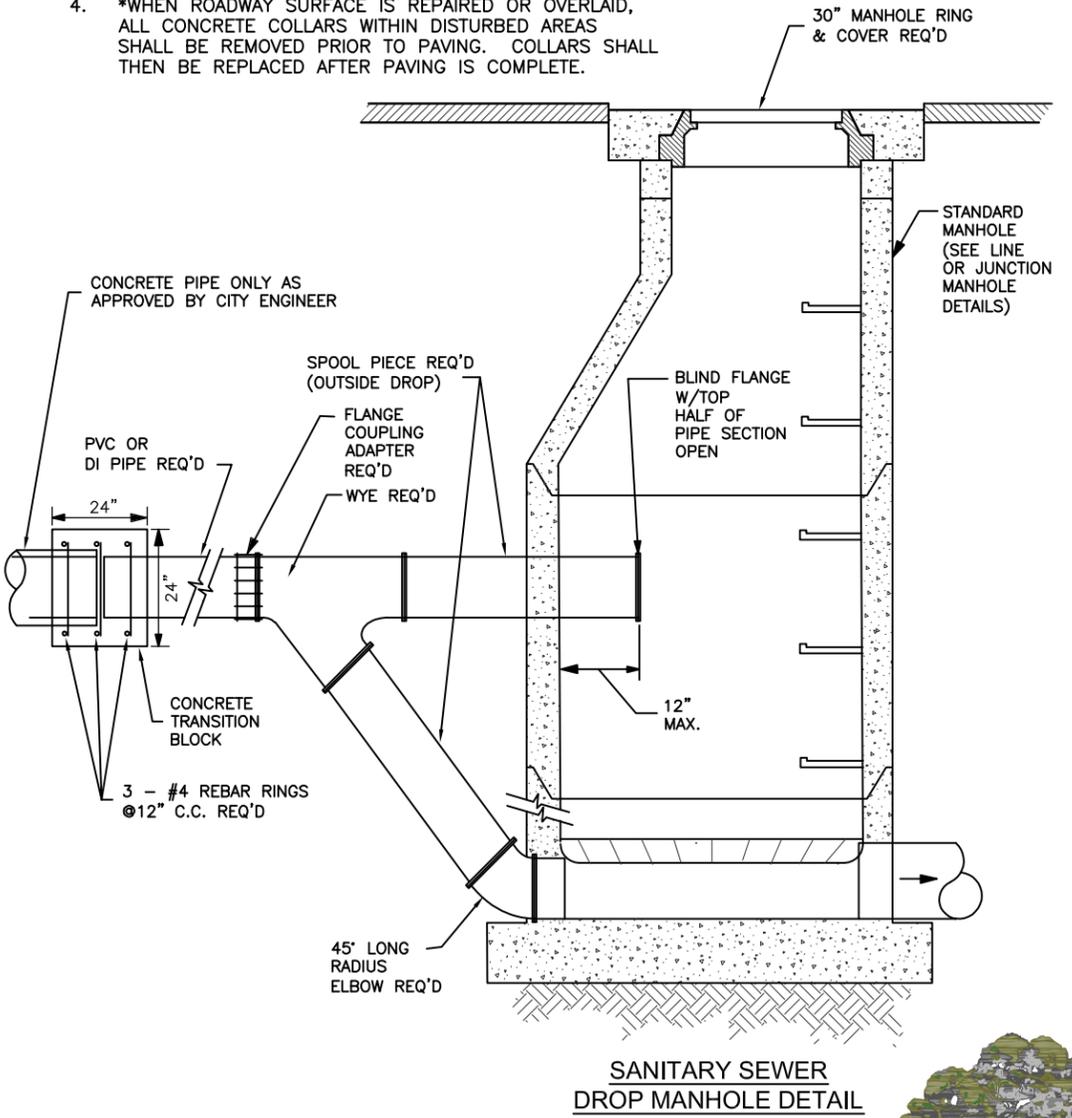


GENERAL NOTES:

1. USE OF DROP MANHOLES ONLY AS APPROVED BY CITY ENGINEER AND CITY PUBLIC WORKS DIRECTOR. DROP MANHOLES MAY BE REQUIRED FOR SEWERS ENTERING 24" OR MORE ABOVE THE INVERT OF THE MANHOLE.
2. LATERAL SHALL NOT ENTER MANHOLES, UNLESS OTHERWISE APPROVED BY CITY ENGINEER AND CITY PUBLIC WORKS DIRECTOR.
3. USE 5' MIN MANHOLE IF THE SUM OF THE DIAMETERS OF ALL THE PIPES ENTERING THE MANHOLE IN INCHES IS GREATER THEN 27". USE 4' DIA MIN. MANHOLE OTHERWISE.
4. *WHEN ROADWAY SURFACE IS REPAIRED OR OVERLAID, ALL CONCRETE COLLARS WITHIN DISTURBED AREAS SHALL BE REMOVED PRIOR TO PAVING. COLLARS SHALL THEN BE REPLACED AFTER PAVING IS COMPLETE.

NOTE:
ON PRECAST MANHOLE BASES,
RUBBER BOOT JOINTS WITH
STAINLESS STEEL CONNECTION
BANDS ARE STANDARD.

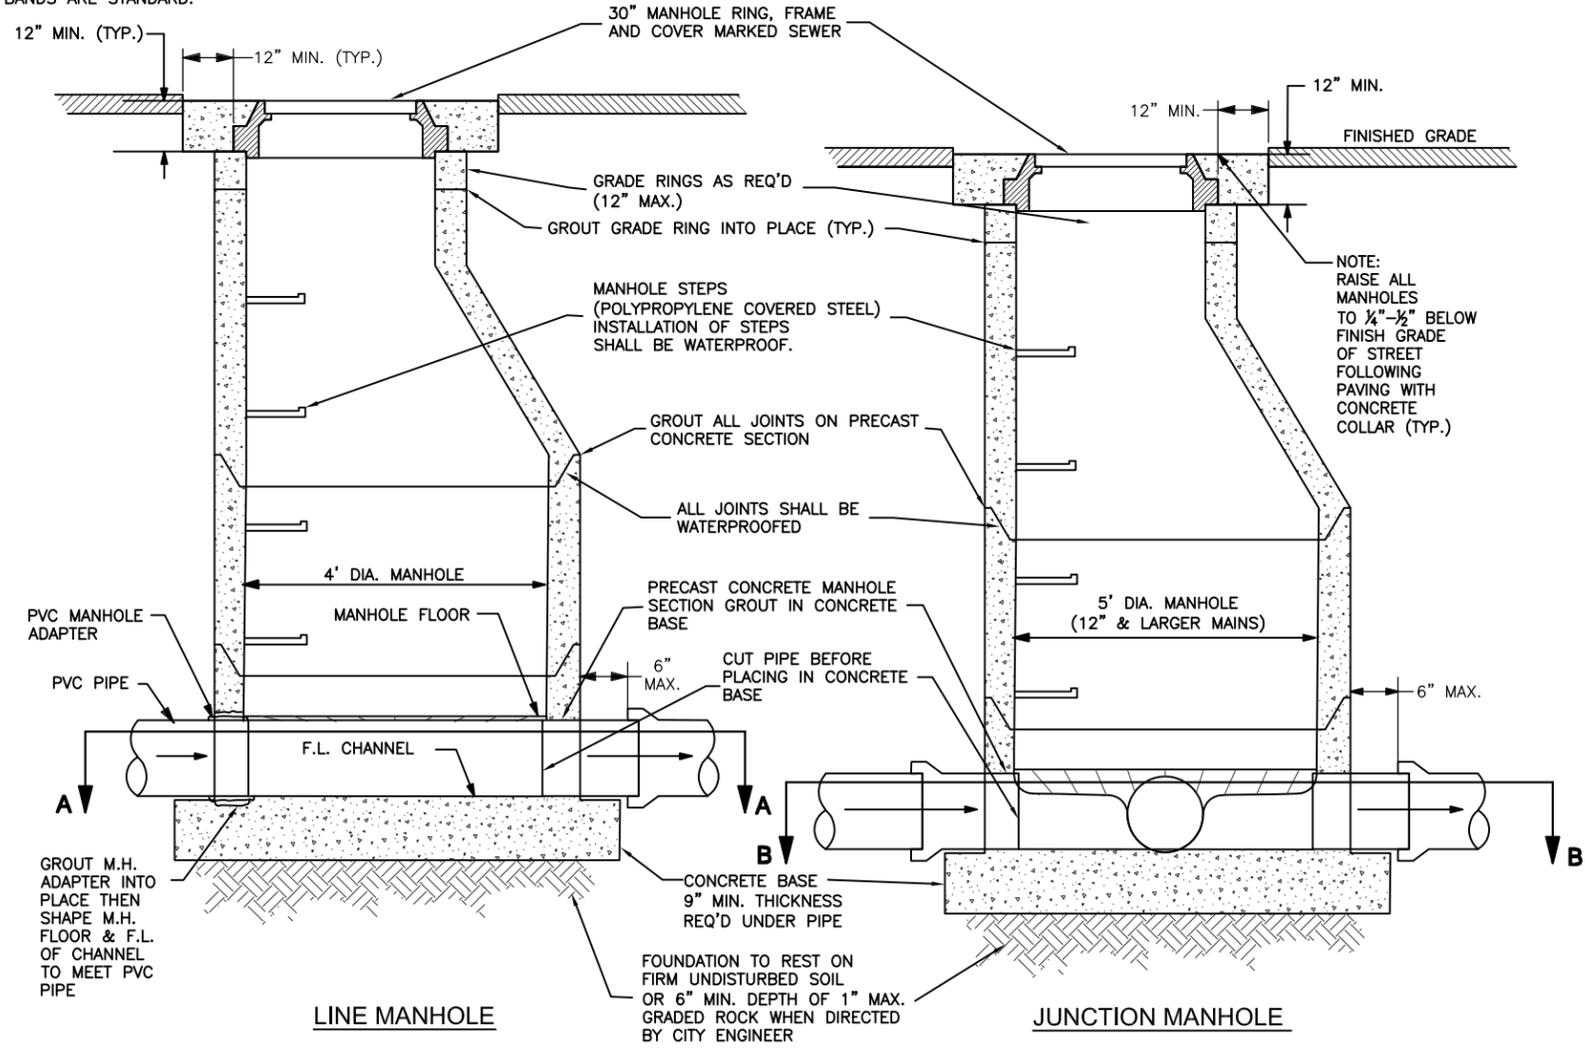

**SANITARY SEWER
DROP MANHOLE DETAIL**



CEDAR HILLS
STANDARD
DRAWING NO.
301